



**Electricity, Resources,
& Building Systems
Integration**

Updating Interconnection Screens for PV System Integration

DOCKET

12-IEP-1D

DATE MAY 14 2012

RECD. MAY 21 2012



May 14, 2012

**California Energy Commission
IEPR Lead Commissioner
Workshop**

**Michael Coddington
Senior Electrical Engineer**



NREL is a national laboratory of the U. S. Department of Energy,
Office of Energy Efficiency and Renewable Energy, operated by
the Alliance for Sustainable Energy, LLC.

PV Trends in the U.S.

- Q3 2011 largest growth of PV installations in U.S. history with 449.2 MW
 - Utility installed solar over 200 MW!
- Q1-Q3 2011 over 1 GW of PV installed in U.S.
- Total PV installed in U.S. over 3.1 GW, more than 10X 2005 levels
- Utility solar installation up 325% from Q1-Q3 2011

Information from 2011 SEIA Report

Topic of the Day: Updating Screens for PV System Integration


Updating Interconnection Screens for PV System Integration

Michael Coddington, Barry Mather, Benjamin Kroposki
National Renewable Energy Laboratory

Kevin Lynn, Alvin Razon
U.S. Department of Energy

Abraham Ellis, Roger Hill
Sandia National Laboratories

Tom Key, Kristen Nicole, Jeff Smith
Electric Power Research Institute

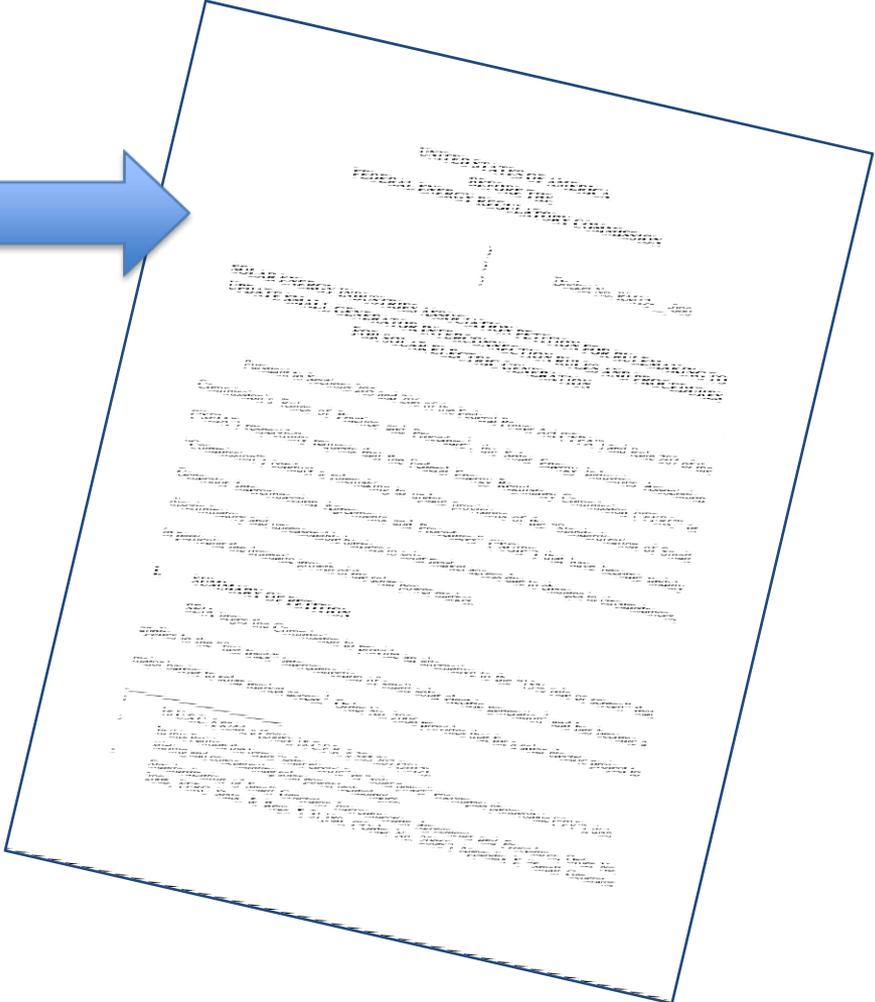

West Hawaii Today

WEDNESDAY, APRIL 4, 2012

WESTHAWAIIITODAY.COM

50¢

Electric exec gets lit up

HELCO PRESIDENT GETS CHILLY RECEPTION AT COUNCIL

BY NANCY COOK LAUER
WEST HAWAII TODAY
ncook.lauer@westhawaiiitoday.com

HILO — Hawaii Electric Light Co. President Jay Ignacio came before a County Council committee Tuesday to clear the air on what he said were misperceptions about the effects of solar and geothermal energy on electric rates.

"Our present challenge is being dependent on the price of oil. We

are aggressively pursuing renewable energy options that will reduce that burden," Ignacio said. "We feel the pain of our customers. ... It's really that dependence on oil that we have to attack."

But rather than calming worried residents, Ignacio's slide presentation brought out a packed house of testifiers, most of them skeptical that HELCO has their best interests in mind. Most members of the council Committee on Agriculture,

Water & Energy Sustainability didn't seem convinced, either.

Concerns about the risks of geothermal and HELCO's apparent resistance to allowing homeowners to hook up their own photovoltaic systems topped the list. Most of the 30 or so testifiers were Puna residents with many of them opposed to geothermal energy for health reasons.

"There was nothing in their presentation that any of their plans

would reduce electric rates," said James Weatherford, a County Council candidate in the Puna district that's home to Puna Geothermal Venture, the state's only geothermal producer, which has a 30-megawatt plant. "No commitment there whatsoever."

Ignacio said HELCO is looking to increase geothermal power as a way to bring a stable source of

► SEE HELCO PAGE 4A

Senate

base. HELCO requires the detailed study when an area of the grid reaches 15 percent saturation with solar energy. Ignacio said 15 percent is the industry standard.

"Those of us on the council represent a lot of angry consumers of electricity," Ford said.

Ignacio's explanation that studies are needed to ensure there aren't dangerous fluctuations and spikes in electric current wasn't enough to satisfy Ford. She pressed

Technical Report Goals

- Increase PV deployment levels
- Educate stakeholders
- Validate concerns for maintaining Reliability, Safety and Cost
- Simplify and improve the interconnection process for utilities and other stakeholders
- Reduce approval time
- Lower interconnection costs per the DOE SunShot Initiative

Why Focus on the 15% Screen?

- Directly relates to the Level of Deployment of PV more than any other screen
- Shows up in the majority of interconnection procedures in the U.S.
- Perceived as a “bottleneck” to PV deployment
- It is a limited metric derived early in interconnection development proceedings
- Field experience challenges the rationale and significance of the 15% screen

Origin of the 15% Screening Criterion

Quoting from CPUC Rule 21 Supplemental Review Guide:

The 15% line section peak load screen is meant as a catchall for a variety of potential problems that can occur as the level of penetration of generation within the distribution system increases.

Problem: “One-Size Fits-All Approach”

Short Term Solutions

Base penetration screen on minimum
daytime load data

- Use actual data rather than a “rule of thumb” which uses half of 30% of peak load
- Minimum load during 10 AM to 2 PM will capture the window of peak annual PV production

Short Term Solutions


Apply Supplemental Screens

- Is the proposed DG a PV system?
- Does the proposed PV pass the quick voltage regulation screen?
- Does the proposed PV pass the quick Anti-Islanding screen?

Short Term Solutions

Zones of Penetration Maps

- Utility models determine locations that will allow greater levels of PV deployment based on location

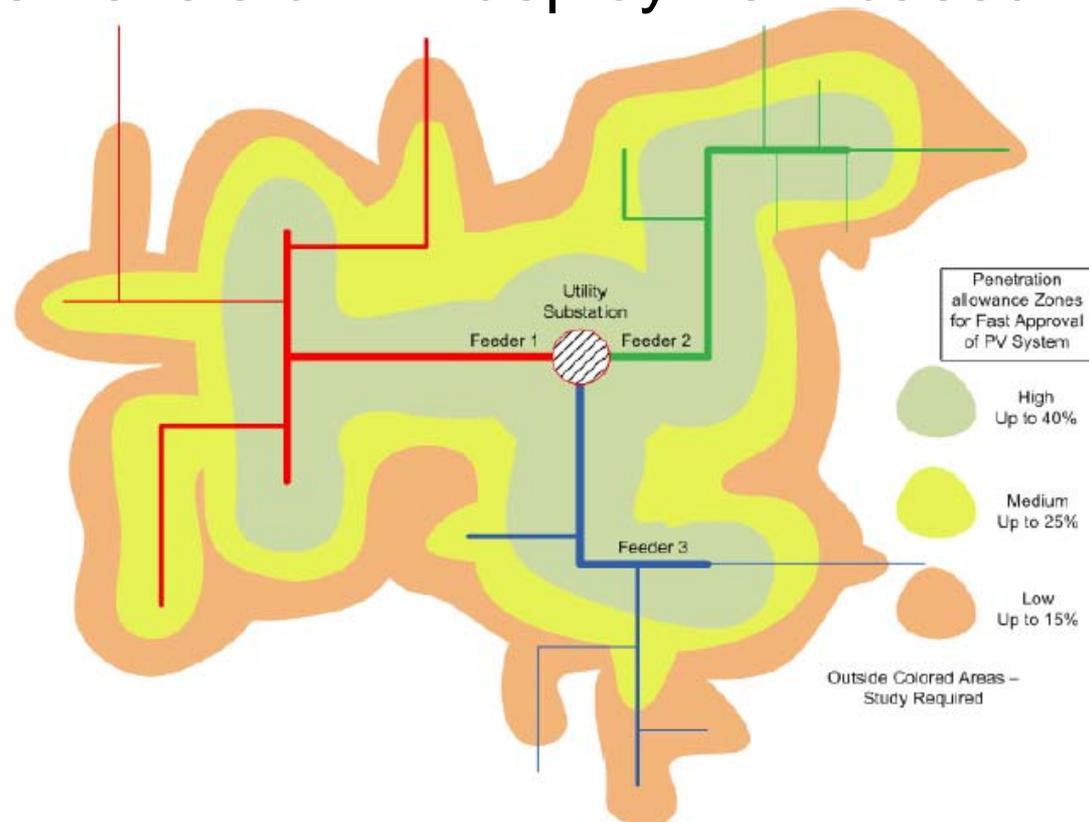

Technical Considerations for PV Location

- Location of PV versus Substation
- Size of conductor / Line impedence
- Presence of voltage regulating devices
- Combined generation on circuit
- Exported power from PV system?
- Presence and location of loads
- Types of loads served by circuit

What have High Penetration Case Studies Shown?

- Circuits can operate safely and reliably on different levels of penetration
- Each feeder is unique and has different abilities to serve load and PV/DG
- Some feeders may operate well at penetration levels over 70%
- Other feeders will have major problems at penetration levels below 10%!
- One-size-fits-all is not acceptable anymore

Mid-Term & Long-Term Solutions

- Model and Validate feeders with PV and develop screening metrics and formulas with Solid Technical Rationale
- Distribution Design Parameters
 - Larger conductors
 - Voltage Regulators
 - Better communications networks
- Advanced Inverter Technology
 - Inverters can be “utility-friendly”
- Low-Cost Storage Solutions?

Advanced Technical Screens

CPUC California Solar Initiative (CSI) Project (EPRI, NREL, SNL, Utilities)

- Evaluate technical screens in CA and US
- Classify feeders into topologies
- Circuit monitoring and case studies
- Modeling of high penetration/other circuits
- Straw man screen development, iterations
- Advanced technical screens based on feeder topology, system parameters, etc. should help reduce barriers to PV deployment



Thank you

Michael.coddington@nrel.gov